

Evaluation Report CCMC 14024-R RadonBlock[™]

 MasterFormat:
 31 21 13 16

 Evaluation issued:
 2015-09-30

 Re-evaluated:
 2018-11-20

1. Opinion

It is the opinion of the Canadian Construction Materials Centre (CCMC) that "RadonBlock™," when used as part of a sub-slab radon gas mitigation system in accordance with the conditions and limitations stated in Section 3 of this Report, complies with the National Building Code (NBC) of Canada 2015:

- Clause 1.2.1.1.(1)(b) of Division A, as an alternative solution that achieves at least the minimum level of performance required by Division B in the areas defined by the objectives and functional statements attributed to the following applicable acceptable solutions:
 - Sentence 9.13.4.2.(1), Protection from Soil Gas Ingress

This opinion is based on CCMC's evaluation of the technical evidence in Section 4 provided by the Report Holder.

Ruling No. 17-02-339 (14024-R) authorizing the use of this product in Ontario, subject to the terms and conditions contained in the Ruling, was made by the Minister of Municipal Affairs and Housing on 2017-03-22 pursuant to s.29 of the *Building Code Act*, 1992 (see Ruling for terms and conditions). This Ruling is subject to periodic revisions and updates.

2. Description

The product is a seven-layer, co-extruded barrier sheet made from polyethylene and ethylene vinyl alcohol (EVOH) resins that provides resistance to gas and moisture transmission. The product is an under-slab barrier designed to restrict naturally occurring gases such as radon and/or methane from migrating through the ground and concrete slab (see Figure 1).

The product is a 0.51 mm (20 mils) thick sheet and available in 3-m (10 ft.) \times 45.7-m (150 in.) rolls. All rolls are folded on heavy-duty cores for ease of handling and installation. The product is available in other custom sizes with factory-welded seams based on minimum volume requirements.

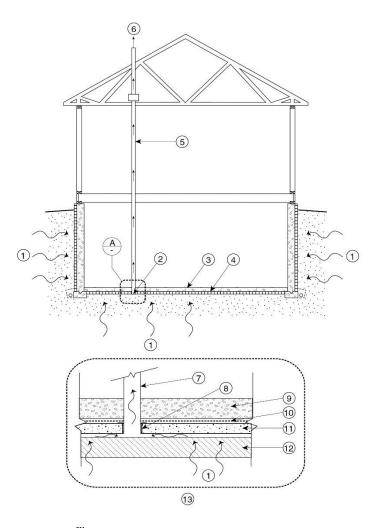


Figure 1. "RadonBlock™" typical assembly

- 1. radon gas
- 2. vent collar flange
- 3. concrete slab
- 4. air barrier system
- 5. radon exhaust vent pipe
- 6. radon exhaust
- 7. radon exhaust vent pipe
- 8. vent collar flange
- 9. concrete slab
- 10. "RadonBlock™,"
- 11. gravel
- 12. undisturbed soil or compacted fill
- 13. Section A

3. Conditions and Limitations

CCMC's compliance opinion in Section 1 is bound by the "RadonBlock" being used in accordance with the conditions and limitations set out below.

- Joints in the product must be lapped not less than 300 mm (12 in.) and must be sealed with butyl tape.
- The product must be installed in accordance with the manufacturer's "RadonBlock™ Installation Guidelines," dated July 15, 2015.
- The product must be used in conjunction with the requirements specified in Subsection 9.13.4., Soil Gas Control, of Division B of the NBC 2015.
- · A floor-on-ground must be sealed around its perimeter to the inner surfaces of adjacent walls using flexible sealant.
- All penetrations of a floor-on-ground that are required to drain water from the floor surface must be sealed in a manner that prevents the upward flow of air without preventing the downward flow of liquid water.

4. Technical Evidence

The Report Holder has submitted technical documentation for CCMC's evaluation. Testing was conducted at laboratories recognized by CCMC. The corresponding technical evidence for this product is summarized below.

4.1 Material Requirements

Table 4.1.1 Results of Testing of Material Properties of the Product

Property		Requirement	Result	
Tensile strength (MPa):	machine direction	Min. 12	25	
	transverse direction	Min. 8	22	
Elongation (%):	machine direction	225	711	
	transverse direction	350	658	
Water vapour permeance (ng/(Pa·s·m²))		Max. 15	0.61	
Impact strength (g)		Min. 300	2 600	
Outdoor weathering resistance		Retain minimum 50% of tensile elongation strength after exposure to accelerated weathering	Pass	

4.2 Performance Requirements

4.2.1 Radon (Rn) Infiltration Test

During the infiltration test, Rn was continuously introduced into the dosing compartment of the RIBETS (National Research Council (NRC) Rn test facility) for three weeks. The air temperature, relative humidity, air pressure, and Rn concentration were monitored continuously in both the dosing and the receiving compartments during this test period. The variations of Rn concentrations in both the dosing and receiving compartments are summarized in Table 4.2.1.

Table 4.2.1 Results of Testing for Comparison of Radon Infiltration through "Radon Guard™" and Prescriptive Gravel

Assembly	Rn Concentration in Dosing Compartment (Bq/m³)	Rn Concentration in Receiving Compartment (Bq/m³)	Result	
Floor assembly with 6 mil poly	5 192	342	The test assembly with the RadonBlock™ and butyl joint tape demonstrated lower permeability to Rn compared to the floor assemblies with the 6 mil poly or the 20 mil poly membranes with conventional sheathing joint tape	
Floor assembly with 20 mil poly	2 260	384		
Floor assembly with "RadonBlock™",	3 362	124		

4.2.2. Sub-slab Depressurization Communication

During sub-slab depressurization communication tests, the in-line Rn exhaust fan was switched on, and it was withdrawing air through sub-slab Rn rough-in PVC pipe from underneath the test membrane samples. The airflow rates through the exhaust stacks and Rn exhaust fan, the pressure in the dosing compartment, the pressure underneath concrete slab, and the pressure underneath the membrane were monitored and recorded at 15-second intervals for 4 hours duration. The average results over the experiment period are presented in Table 4.2.2.

Table 4.2.2 Comparison of Sub-slab Depressurization Communication for Membrane Tests

Assembly	Flow Rate Through Exhaust Fan (L/s)	Pressure Under Concrete Slab (Pa)	Pressure Under Membrane (Pa)	Pressure in Dosing Compartment (Pa)	Pressure in Receiving Compartment (Pa)	Result
Floor assembly with 6 mil poly	26.6	-1.8	-3.1	-30.0	-0.9	"RadonBlock", 6 mil poly and 20 mil poly membranes produced comparable results during the sub-slab pressure communication tests
Floor assembly with 20 mil poly	25.2	-3.0	-3.0	-29.4	-4.4	
Floor assembly with "RadonBlock""	28.9	-0.6	-3.1	-29.8	-2.3	

Report Holder

Radon Environmental 450-1040 West Georgia Street Vancouver, BC V6E 4H1

Telephone: 778-327-4717

Fax: 778-327-4716

Email: david.innes@radoncorp.com
Web site: www.radoncorp.com

Plant(s)

Sioux Falls, SD, USA

Disclaimer

This Report is issued by the Canadian Construction Materials Centre, a program of the NRC Construction Research Centre at the National Research Council of Canada. The Report must be read in the context of the entire CCMC Registry of Product Evaluations, including, without limitation, the introduction therein which sets out important information concerning the interpretation and use of CCMC Evaluation Reports.

Readers must confirm that the Report is current and has not been withdrawn or superseded by a later issue. Please refer to http://www.nrc-cnrc.gc.ca/eng/solutions/advisory/ccmc_index.html, or contact the Canadian Construction Materials Centre, NRC Construction Research Centre, National Research Council of Canada, 1200 Montreal Road, Ottawa, Ontario, KIA 0R6. Telephone 613-993-6189. Fax 613-952-0268.

NRC has evaluated the material, product, system or service described herein only for those characteristics stated herein. The information and opinions in this Report are directed to those who have the appropriate degree of experience to use and apply its contents. This Report is provided without representation, warranty, or guarantee of any kind, expressed, or implied, and the National Research Council of Canada (NRC) provides no endorsement for any evaluated material, product, system or service described herein. NRC accepts no responsibility whatsoever arising in any way from any and all use and reliance on the information contained in this Report. NRC is not undertaking to render professional or other services on behalf of any person or entity nor to perform any duty owed by any person or entity to another person or entity.

Date modified:

2018-11-20